


Pool Mesh

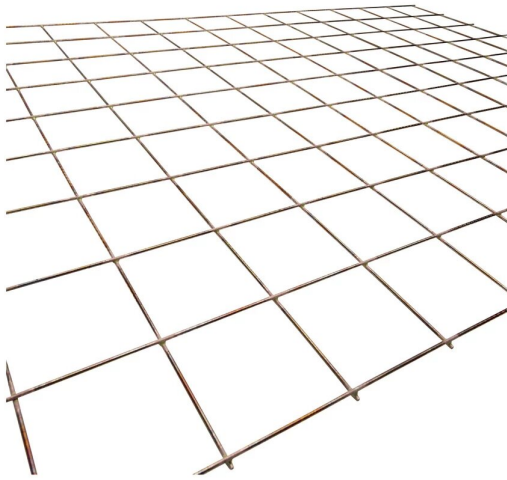

The requirements for bonding and grounding permanently installed indoor and outdoor swimming pools are provided in Article 680 "Swimming Pools, Fountains and Similar Installations" of the 2005 Edition of the National Electrical Code (NEC®). All of the bonded parts in or around swimming pools must be attached to an equipotential bonding grid. This grid must extend 3' (0.91 m) beyond the inside surface of the pool under concrete, stone or other paved walking surfaces.

Please note that pools made of non-conductive materials (fiberglass composite, vinyl lined polymer or other non-conductive materials) do not require an equipotential grid that covers the full contour of the bottom and sides of the pool. However, an equipotential grid is still required around the perimeter of the pool extending 3' (0.91 m) beyond the sides of the pool.

FEATURES


Convenient, efficient and economical solution for equipotential bonding grids for swimming pool applications

Material: Copper



SPECIFICATIONS

Catalog Number	Length 1 (L1)	Width 1 (W1)	Grid Spacing (L2 x W2)	Conductor Size
POOLMESH2100 	100'	2'	12" x 12"	#8 Solid
POOLMESH250 	50'	2'	12" x 12"	#8 Solid
POOLMESH3100 	100'	3'	12" x 12"	#8 Solid
POOLMESH350 	50'	3'	12" x 12"	#8 Solid

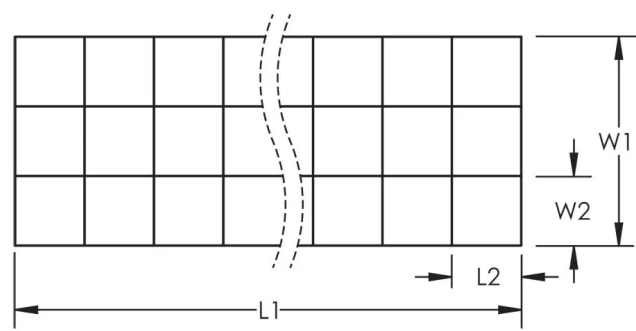

WARNING

nVent products shall be installed and used only as indicated in nVent's product instruction sheets and training materials. Instruction sheets are available at www.nvent.com and from your nVent customer service representative. Improper installation, misuse, misapplication or other failure to completely follow nVent's instructions and warnings may cause product malfunction, property damage, serious bodily injury and death and/or void your warranty.

North America

+1.800.753.9221
Option 1 – Customer Care
Option 2 – Technical
Support

Europe

Netherlands:
+31 800-0200135
France:
+33 800 901 793

Europe

Germany:
800 1890272
Other Countries:
+31 13 5835404

APAC

Shanghai:
+ 86 21 2412 1618/19
Sydney:
+61 2 9751 8500

